

The D9069P DACT Programmer DACT-PRG is an alphanumeric LCD Keypad used for all programming and debugging of the Advanced D9068P Digital Alarm Communicator Transmitter (DACT). The DACT-PRG has a two-line, 16-character display that shows information on various D9068P DACT programming features/functions. In most cases, the first line shows general system (D9068P) status information and the second line describes the specific programming menus and prompts.

The DACT-PRG is connected via a 5 pin female connector to the AX-SEB Serial Expansion Board PL3 connector. While the DACT-PRG is connected to the D9068P DACT, communications to the central station is suspended and the Axis AX Series Intelligent Fire Alarm Control Panel will initiate a DACT trouble.

Once the D9068P is programmed by the DACT-PRG and the Axis AX Series Intelligent Fire Alarm Control Panel is set for serial Contact-ID or SIA-300 protocol communications, the D9068P DACT will receive real time system status information from the Axis AX Series Intelligent Fire Alarm Control Panel and transmit this status to a wide variety of listed Central Station receivers.



Features



- Programs D9068P DACT
- Permits Manual Testing of D9068P DACT
- 2 - Line, 16 - Character Display
- User-Friendly Scrolling Program Menus
- D9068P DACT Historical Display

Listings and Approvals

- ETL ANSI/UL 864 Listed: 101564744NYM-001
- UL Listed UOXX.S5579
- CSFM Approved: 7165-1713:0101
- NYCFD COA #6105A2

Specification

Voltage	10.2 - 28 VDC
Connection	Four Screw Terminals Power and Communications
Environment	Indoor, Dry
Temperature (Operating)	32 °F - 120 °F (0 °C - 49 °C)
Dimensions (H X W X D)	4.7" X 6.2" X 1.2"
Weight	9.1 Ounces

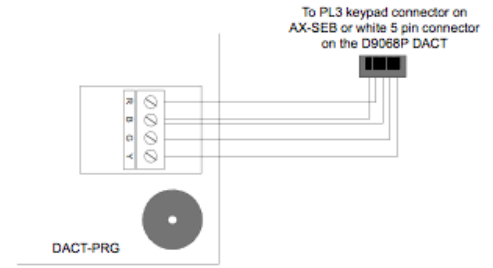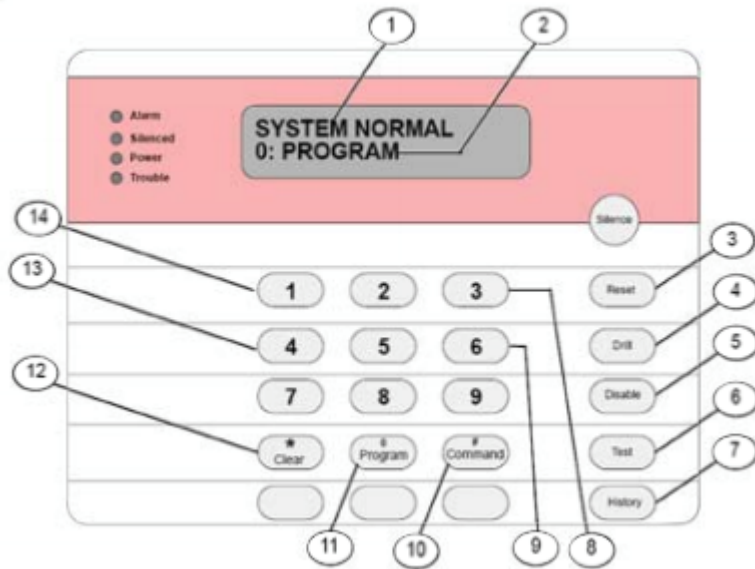

DACT-PRG Wiring

- 1 First Line of Display
- 2 Second Line of Display
- 3 [Reset] Key: Initiates a Manual Reset of D9068P. Clears the Character Selected by the Cursor.
- 4 [Drill] Key: Advances to the next programmable feature or character position.
- 5 [Disable] Key: Returns to the previous programmable feature or character position.
- 6 [Test] Key: Enters Test Mode. Pressing [Test] when entering a phone number, accesses three phone control code option.
- 7 [History] Key: Enters History Mode.
- 8 [3] Key: Increases DACT-PRG backlight intensity. Press and hold [* Clear] first. Then press [3] to adjust the intensity.
- 9 [6] Key: Decreases DACT-PRG backlight intensity. Press and hold [* Clear] first, then press [6] to adjust the intensity
- 10 [# Command] Key: Accepts programming entries into D9068P. Press this key after every programming entry.
- 11 [0 Program] Key: Enters the Programming Mode menu
- 12 [* Clear] Key: Cancels any programming menu without making changes. Return to the message SYSTEM NORMAL by pressing [* Clear] until SYSTEM NORMAL appears across the first line.
- 13 [4] Key: Decreases DACT-PRG sounder volume. Press and hold [* Clear] first, then press [4] to adjust the volume.
- 14 [1] Key: Increases DACT-PRG sounder volume. Press and hold [* Clear] first, then press [1] to adjust the volume.

Order Codes and Options

DACT-PRG	LCD Keypad for Programming D9068P DACT
----------	--

[Check if this document is up to date](#) | [Give us feedback](#)

Advanced, 100 South Street, Hopkinton, MA. 01748 T: +508 435 9995 E: usa@advancedco.com W: us.advancedco.com

As our policy is one of constant product improvement the right is therefore reserved to modify product specifications without prior notice.